BACKYARD RAIN GARDEN

RA	IN GARDEN SITE REQUIREMENTS					
1.	DISTANCE TO BUILDING FOUNDATION:(10 FEET MINIMUM)					
2.	DISTANCE TO SEPTIC SYSTEM DRAINFIELD:(25 FEET MINIMUM)					
3.	DISTANCE TO WELL HEAD:(25 FEET MINIMUM)					
4.	UPSLOPE DOWNSLOPE FROM WELL HEAD (CIRCLE ONE, DOWNSLOPE RECOMMENDED)					
5.	5. UPSLOPE DOWNSLOPE LATERAL TO SEPTIC DRAINFIELD (CIRCLE ONE, LATERAL RECOMMENDED)					
6.	SUN EXPOSURE IS FULL PARTIAL (CIRCLE ONE)					
7.	DEPTH TO SEASONAL HIGH WATER TABLE:(>30 INCHES RECOMMENDED)					
so	IL DATA					
1.	PREDOMINANT SOIL TYPE:(FROM SOIL SURVEY)					
2.	POST RAINFALL CONDITION OF PROPOSED RAIN GARDEN LOCATION ACCORDING TO LANDOWNER: WET OR SATURATED 1.5 DAYS AFTER RAINFALL? IF YES, SELECT ALTERNATE SITE.					
3.	DEPTH TO WETLAND SOILS IN 24-INCH DEPTH TEST PIT: INCHES IF WETLAND SOILS (GREY WITH RIBBONS OF BROWN) ARE OBSERVED WITHIN 12 INCHES OF SURFACE, SITE IS UNSUITABLE FOR RAIN GARDEN.					
4.	IS WATER PRESENT IN TEST PIT, 36 HOURS AFTER COMPLETE FILLING WITH WATER? YES NO (CIRCLE ONE).					
	ANY WATER PRESENT WITHOUT ADDITIONAL RAINFALL INDICATES POORLY DRAINED SITE. IF PIT DRAINS COMPLETELY, REFILL AND CHECK AFTER 12 HOURS. A COMPLETELY DRAINED PIT CHARACTERIZES A WELL DRAINED SITE.					
RU	NOFF VOLUME					
то	TAL WATERSHED AREA (A) = SQUARE FEET					
AR	REA OF IMPERVIOUS SURFACES (Ai) = SQUARE FEET					
IMF	PERVIOUS PERCENTAGE OF WATERSHED (I) = Ai/A =					
RU	NOFF COEFFICIENT (Rv) = 0.05 + [0.009 * (I * 100)] =					
ST	ORM PRECIPITATION (P): (1.5 INCHES FOR CAMA COUNTIES, 1.0 INCH FOR ALL OTHERS					
RH	INOFF VOLUME (V) = Rv * A * (P/12) = CURIC FFFT**					

SITE MAP

SCALE:



ADDRESS:

** REFER TO APPENDIX D OF CCAP STORMWATER BMP DESIGN MANUAL FOR RAIN GARDEN SIZING CHARTS.

LANDOWNER:_____ADDRESS:_____

REVISIONS					
NO. BY DATE DESCRIPTION					
1	JLY	12-03-08	MODIFIED RUNOFF (Rv) EQUATION		
2	JMZ	08-11-10	MINOR EDITS	سا	
3				 c	
4				╟─	
5				ll s	


 PROJECT #:
 SCALE:

 DRAWN BY:
 DATE:

 CHECKED BY:
 DATE:

 SHEET NO. 1 OF 3
 FILENAME: RAINGARDEN1.DWG


RAIN GARDEN SIZE			
RAIN GARDEN PONDING DEPTH (Dp):	(3, 6 (OR 9-INCHES RECOMMENDED)	
SURFACE AREA = RUNOFF VOLUME (V) / PONDING DEPTH (FEET) =	= V/(Dp/12) =	SQUARE FEET
NOTE: BOTTOM OF RAIN GARDEN MAHOURS. GRADE BOTTOM WITH ZONE THAT CANNOT TOLERATE WET CONDEREQUIRED SURFACE AREA. FOR EXAMPLE AVERAGE DEPTH IS 7.5-INCHES.	S AT DIFFERENT ELEVATION ITIONS FOR EXTENDED PERI	S TO IMPROVE SURVIVAL OF BIO ODS. DETERMINE AVERAGE DEF	RETENTION PLANTS PTH TO CALCULATE
PEAK STORMWATER RUNOFF USING	RATIONAL METHOD		
C = RUNOFF COEFFICIENT = [(IMPERV	IOUS AREA x 0.95) + (PERVIC	DUS AREA x 0.25)] / DRAINAGE AR	EA=
I = STORM INTENSITY (10-YEAR STORI MANUAL =IN		ON) FROM TABLE 3.1 OF CCAP BM	IP DESIGN
A = WATERSHED AREA DRAINING INTO	O BMP =	ACRES	
PEAK FLOW FROM WATERSHED DURI	NG 10-YEAR STORM EVENT =	= Q = C x I x A	
Q = PEAK FLOW =	_ CUBIC FEET PER SECOND		
OUTLET WEIR DESIGN			
Cw = WEIR COEFFICIENT = 3.0			
H = HEIGHT OF WATER OVER TOP OF	WEIR =	FEET (0.5 FEET MAXIMUM)	
Q = PEAK FLOW =	CUBIC FEET PER SECON	D	TOP OF BER
L = LENGTH OF WEIR = $Q / (C_w \times H^{1.5}) =$	FEE1	-	
NOTES:			
ORTH CAROLINA FIELD OFFICE:	\LAN	NDOWNER:	

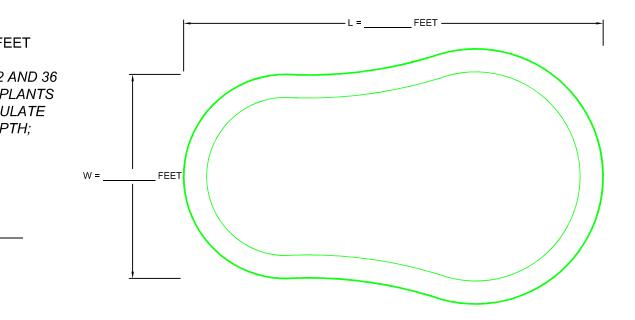

NOTE: LOCATE ALL INLET AND OUTLET LOCATION(S)

MARK ANY ZONES OF VARYING BOTTOM ELEVATIONS

PLAN NOT TO SCALE

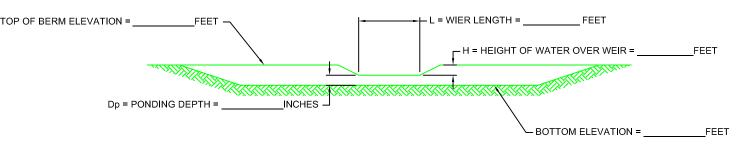

CROSS SECTION

NOT TO SCALE

WARNING:

LOCATE ALL UNDERGROUND UTILITIES BEFORE DIGGING. CALL **1-800-632-4949** FOR BURIED UTILITY LOCATION SERVICE.

NORTH CAROLINA FIELD OFFICE:	LANDOWNER:	NO.	BY	REVISIONS DATE DESCRIPTION	PROJECT#:	SCALE:	
SOIL&WATER ADDRESS:		1			DRAWN BY:	DATE:	
	ADDRESS:	 3			CHECKED BY:	DATE:	
CONSERVATION PHONE:		5			SHEET NO. 2 OF 3	FILENAME: RAINGARDEN2.DWG	